


Appendix C1

consumption of domestic load every hour

Time	S (KVA)
08:30	12.3
08:40	12.05
08:50	12.45
09:00	11.9
09:10	12.5
09:20	12.28
09:30	12.51
09:40	12.3
21:50	11.8
22:00	12.1

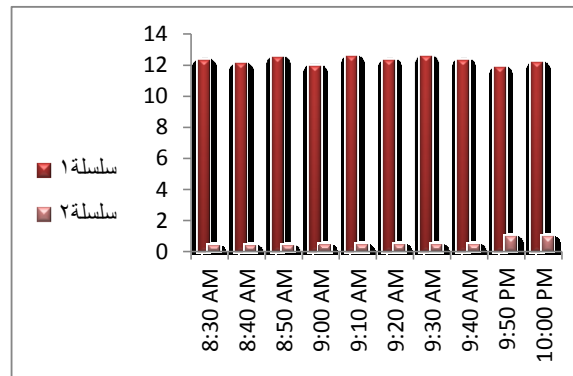


Rated : 400 KVA
load 1
Date of record 2017
region : اسطاس

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
08:30	234.2	234.5	234.5	416.15	415.58	417.15	53.26	45.3	38.7	12.3	0.83
08:40	234.5	234.6	234.7	416.25	415	417	52.2	44.6	36	12.05	0.81
08:50	234.5	234.6	234.7	415.28	415.12	417.15	53.1	42.6	38.5	12.45	0.85
09:00	234.5	234.6	234.5	416	415.15	417.18	51	44.5	33.9	11.9	0.79
09:10	234.4	234.3	234.6	416.21	415.25	417.23	52.5	45.2	34.3	12.5	0.88
09:20	234.4	234.4	234.4	416	415.24	417	51.99	41.01	37.3	12.28	0.83
09:30	234.5	234.5	234.4	416.24	416	417.28	53.1	44.1	35.3	12.51	0.88
09:40	234.2	234.3	234.5	416.25	417.5	417	53.11	41.25	38	12.3	0.83
21:50	234.4	234.6	234.5	416.85	417	417.4	50.2	43.1	37.7	11.8	0.75
22:00	234.5	234.4	234.45	417	415.21	416.98	52.9	45.2	33.9	12.1	0.81
avreg value							52.336	43.686	36.36	12.219	0.826
max. value							53.26	45.3	38.7	12.51	0.88

VEGA 78 Data for Domestic Load2

Time	S (KVA)
08:30	41.8
08:40	41.7
08:50	40.8
09:00	40.2
09:10	41.7
09:20	41
09:30	41.8
09:40	41.1
09:50	41.5
10:00	40.7

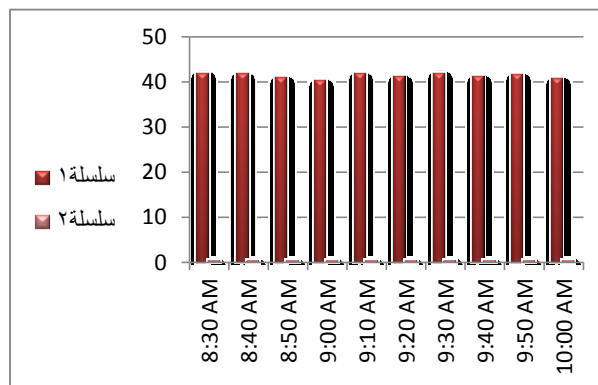

ادغيبس


630KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
08:30	237.2	237	237.6	410.66	411.35	410.85	181	175.9	165.3	41.8	0.95
08:40	237.4	237.2	237.8	411.05	411.61	411.18	180.3	175.6	162.2	41.7	0.94
08:50	237.4	237.2	237.8	411.11	411.5	411.19	181	172.3	165.3	40.8	0.9
09:00	237.6	237.4	237.98	411.55	411.85	410.5	179.6	173.9	161	40.2	0.88
09:10	237.6	237.4	237.9	411.51	411.83	411.52	179	175	163.3	41.7	0.93
09:20	237.6	237.5	238	410.9	411.99	411.53	180.6	170.7	165.1	41	0.91
09:30	237.6	237.5	237.9	411.48	411.95	411.43	180.5	174.3	164	41.8	0.95
09:40	237.7	237.5	238	411.62	412.05	411.72	181	172.1	160.3	41.1	0.91
09:50	237.7	237.6	238.1	411.69	412.23	411.66	179.4	175.2	159.2	41.5	0.93
10:00	237.5	237.4	237.9	411.38	411.91	411.46	181	171.9	162.3	40.7	0.9
avg. value									162.8	41.23	0.92
max. value							181	175.9	165.3	41.8	0.95

VEGA 78 Data for Domestic Load 3

Time	S(KVA)
12:02	21
12:12	21
12:22	20.7
12:32	20.5
12:42	21
12:52	20.5
01:02	20.7
01:12	20.4
01:22	20.5
01:32	20.5

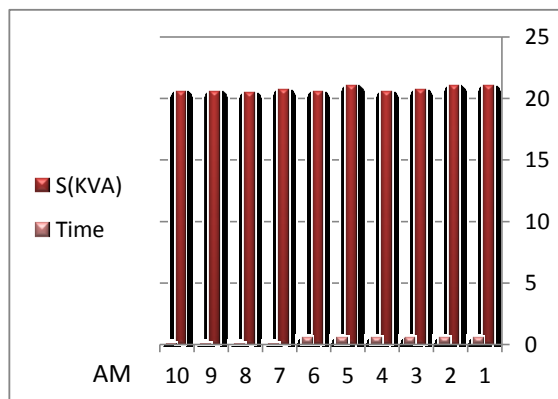

هاني الترك


Rated : 630 KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2(A)	I3 (A)	S(KVA)	PF
12:02	235	235.5	236.1	407.37	408.7	407.9	79.5	90.9	72.3	21	0.92
12:12	235	235.5	236.1	407.37	408.65	407.78	79	90.2	70.3	21	0.92
12:22	235.2	235.7	236.3	407.68	409.02	408.15	77.6	88.3	72.3	20.7	0.9
12:32	234.6	235.1	235.8	406.72	408.21	407.24	79.2	85.6	69.6	20.5	0.89
12:42	235	235.2	235.8	407	408.1	407.3	75.3	89.2	67.6	21	0.92
12:52	234.7	234.9	235.8	406.86	407.8	407.3	77.1	87.3	71.2	20.5	0.9
01:02	234.7	235.3	235.9	407.06	408.29	407.34	79	90.2	70.6	20.7	0.91
01:12	234.8	235.3	236	407.1	408.45	407.45	79.5	88.9	72.2	20.4	0.88
01:22	234.7	235.2	235.9	407.14	408.29	407.15	78.2	90.2	70.01	20.5	0.89
01:32	234.5	235.1	235.9	406.71	408.19	406.86	78.3	87.3	69.2	20.5	0.9
avg. value							78.27	88.81	70.531	20.68	0.903
max. value							79.5	90.9	72.3	21	0.92

VEGA 78 Data for Domestic Load4

Time	S (KVA)
10:15	18.3
10:25	18.3
10:35	18.1
10:45	18.2
10:55	18.3
11:05	18
11:15	18.1
11:25	18.3
11:35	18.3
11:45	17.9

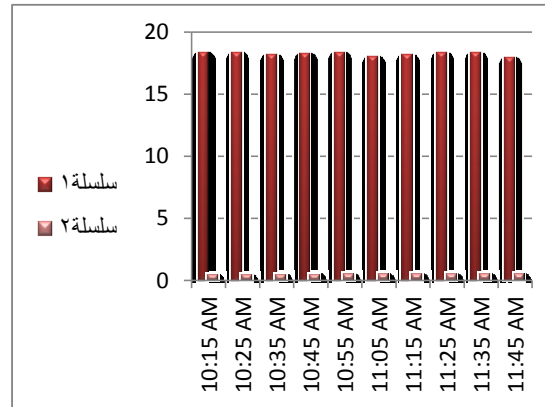

الحورة (وجيه)


Rated : 150 KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
10:15	239	239.2	239.2	413.91	415.11	413.73	73.2	67.2	82.3	18.3	0.84
10:25	239	238	239.4	413.97	415.13	414.01	72.2	63.2	80.2	18.3	0.84
10:35	238.9	239.1	239.3	413.76	414.88	413.8	71.2	66.3	81.5	18.1	0.83
10:45	239.2	239.4	239.3	414.2	415.22	413.96	73	67.1	79.3	18.2	0.82
10:55	239	239.2	239.1	413.4	414.86	412.9	73.2	62.5	77.6	18.3	0.84
11:05	238.9	239.5	239.6	414.36	415.61	414.02	70	64.1	80.5	18	0.81
11:15	238.4	239.2	239	413.1	414.6	413.01	69.5	64.9	82.2	18.1	0.83
11:25	238.5	239	238.9	413.22	414.66	412.98	71.2	67.1	72.3	18.3	0.84
11:35	238.5	239.1	239	413.11	414.86	413.18	72.012	60.2	80.2	18.3	0.84
11:45	238.3	238.8	238.8	412.76	414.52	412.53	68.2	65.2	81.5	17.9	0.8
avg. value							71.3712	64.78	79.76	18.18	0.829
max. value							73.2	67.2	82.3	18.3	0.84

VEGA 78 Data for Domestic Load 5

Time	S (KVA)
13:45	90
13:55	90.2
14:05	90.2
14:15	89.1
14:25	89.5
14:35	89.3
14:45	88.9
14:55	87.2
15:05	88.4
15:15	88

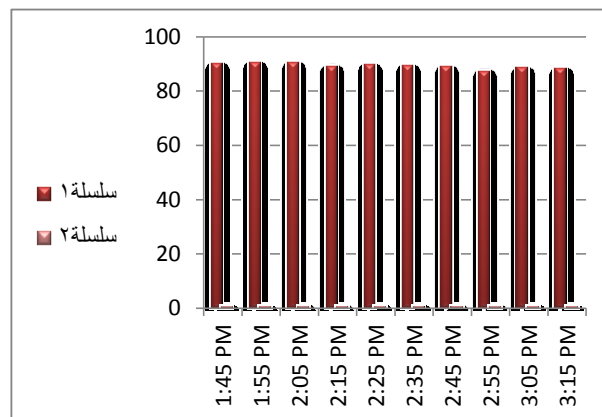

الحورة (رسمي)


Rated : 630 KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
13:45	237.5	236.7	236	411.11	409.49	409.37	389	153.2	138	90	0.89
13:55	237.6	236.9	236.2	411.73	409.9	409.62	384	150.2	138.6	90.2	0.9
14:05	237.8	237.1	236.4	411.74	410.23	409.96	375	153.6	136.8	90.2	0.9
14:15	237.7	236.9	236.2	411.51	409.94	409.69	388	149.2	136.7	89.1	0.88
14:25	237.8	237.1	236.4	411.69	410.24	409.83	379	152	137	89.5	0.9
14:35	237.6	237	236.2	411.53	410	409.7	384.3	153.2	136.3	89.3	0.89
14:45	236.9	236.6	236	410.89	409.36	409.04	389	144.2	136.1	88.9	0.87
14:55	237.2	236.6	235.8	411	409.6	409.7	380.6	146.7	136.9	87.2	0.87
15:05	237	236.5	235.7	410.5	409.03	408.66	374.3	148.8	134.2	88.4	0.9
15:15	237	236.6	235.8	410.51	409.28	408.92	379.2	149.3	126.5	88	0.9
avg. value							382.24	150.04	135.71	89.08	0.89
max. value							389	153.6	138.6	90.2	0.9

VEGA 78 Data for Domestic Load 6

Time	S (KVA)
20:45	36.3
20:55	36
21:05	36.1
21:15	36.1
21:25	35.9
21:35	36.3
21:45	36.3
21:55	35.7
22:05	36
22:15	36.1

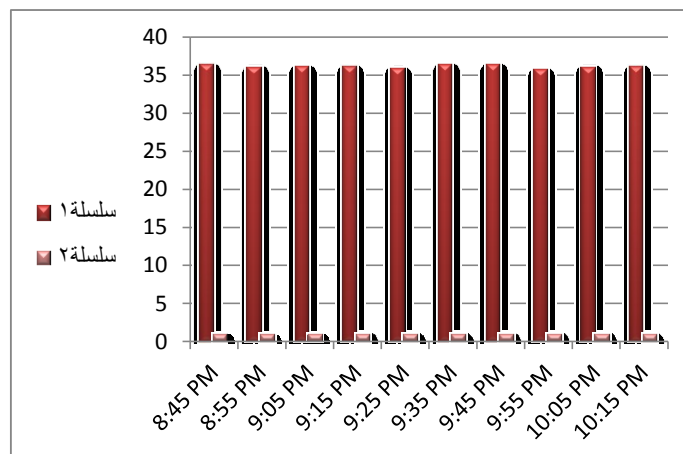

كروم الغرباء (ابو عماد)


Rated : 400 KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
20:45	235.6	234.3	233.7	406.18	405.07	407.37	142.3	152	167.6	36.3	0.97
20:55	235.6	234.3	233.8	406.24	405.15	407.44	142.3	152.2	167.1	36	0.95
21:05	235.7	234.4	233.9	406.49	405.36	407.6	142.2	152.1	167.5	36.1	0.96
21:15	235.7	234.4	233.8	406.46	405.18	407.51	142.3	151.6	166.2	36.1	0.96
21:25	235.8	234.5	234	406.54	405.52	407.76	141.2	151.9	162.3	35.9	0.95
21:35	235.2	233.9	233.4	405.62	404.5	406.65	141.2	150.9	164.6	36.3	0.97
21:45	235.7	234.5	233.9	406.58	405.48	407.41	140.3	151.6	166.8	36.3	0.97
21:55	235.6	234.4	233.7	406.32	405.19	407.28	140.3	149.6	167.7	35.7	0.94
22:05	235.6	234.4	233.7	406.42	405.15	407.23	141.2	149.3	167.6	36	0.96
22:15	235.5	234.3	233.7	406.2	405.01	407.14	139.2	152	162.8	36.1	0.96
avg. value							141.25	151.32	166.02	36.08	0.959
max. value							142.3	152.2	167.7	36.3	0.97

VEGA 78 Data for Domestic Load7

Time	S (KVA)
00:00	150
12:10	150.2
12:20	150.3
12:30	150.6
12:40	150.4
12:50	150.2
13:00	150
13:10	150.2
13:20	150.4
13:30	150.8

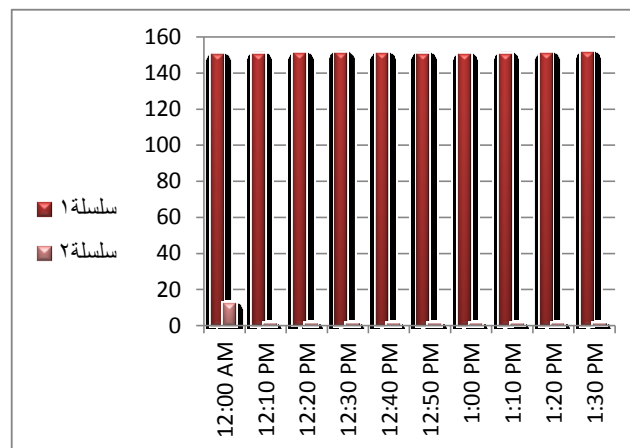

Rated : 630 KVA


وسط البلد

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
00:00	239.3	238.8	238.6	414.05	413.53	413.59	649.5	435	584	150	0.9
12:10	239.4	238.9	238.9	414.34	413.8	414.09	649.5	435.2	584.3	150.2	0.91
12:20	239.1	238.6	238.78	413.81	413.38	413.49	649.5	435.6	584.6	150.3	0.91
12:30	239.2	238.7	238.8	414.3	413.65	413.61	649.8	435.2	584.5	150.6	0.91
12:40	238.9	238.4	238.5	413.56	413.1	413.04	649.7	435.2	584.2	150.4	0.89
12:50	138.5	238.7	238.9	413.86	413.89	413.5	647.5	435.6	584.2	150.2	0.88
13:00	239.1	238.7	238.7	414.05	413.49	413.43	648.7	435.6	584.2	150	0.9
13:10	239.3	238.8	239	414.6	414.1	413.74	647.5	435.42	584.6	150.2	0.9
13:20	238.7	238.7	237.9	414.02	414.23	413.54	648.2	435	584.7	150.4	0.85
13:30	238.5	238.2	238.41	414.35	414.12	413.26	647.5	435.2	554.6	150.8	0.91
avg. value							648.74	435.302	581.39	150.31	0.896
max. value							649.8	435.6	584.7	150.8	0.91

VEGA 78 Data for Domestic Load 8

Time	S (KVA)
02:00	14.5
02:10	14.5
02:20	14.7
02:30	14.3
02:40	14.3
02:50	14
03:00	14.5
03:10	14.5
03:20	14.1
03:30	13.7

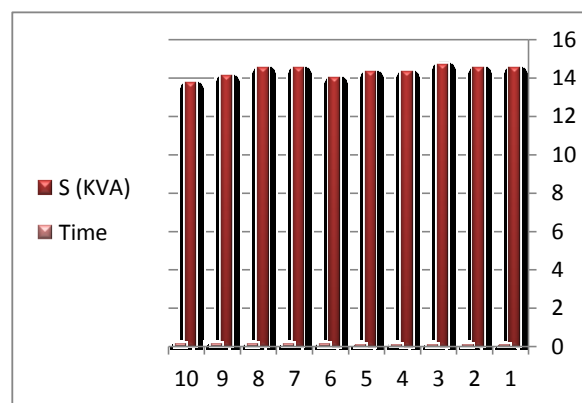

قرنة الفنية


Rated : 250 KVA

Date of record /2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
02:00	239.3	238.8	238.6	414.05	413.53	413.59	48.2	62.8	55.3	14.5	0.9
02:10	239.4	238.9	238.9	414.34	413.8	414.09	48.2	62.3	55.3	14.5	0.9
02:20	239.1	238.6	238.78	413.81	413.38	413.49	48.6	62.8	55.2	14.7	0.92
02:30	239.2	238.7	238.8	414.02	413.65	413.61	47.3	62.8	55.4	14.3	0.91
02:40	238.9	238.4	238.5	413.56	413.1	413.04	47.3	62.5	55.6	14.3	0.91
02:50	239	238.7	238.9	413.86	413.89	413.47	48.3	62.4	55.8	14	0.88
03:00	239.1	238.7	238.7	414.05	413.49	413.43	48.2	62.3	55	14.5	0.92
03:10	239.3	238.8	239	414.15	414.1	413.74	48.2	62.8	55.8	14.5	0.92
03:20	238.7	238.7	237.9	414.02	414.23	413.54	48.23	62.5	55.7	14.1	0.9
03:30	238.5	238.2	238.41	414.35	414.12	413.26	48.5	62.5	55.7	13.7	0.87
avg. value							48.103	62.57	55.48	14.31	0.903
max. value							48.6	62.8	55.8	14.7	0.92

VEGA 78 Data for Domestic Load 9

Time	S (KVA)
12:30	3.2
12:40	3.2
12:50	3
13:00	3.1
13:10	3.2
13:20	2.9
13:30	3
13:40	2.9
13:50	3.1
14:00	3.2

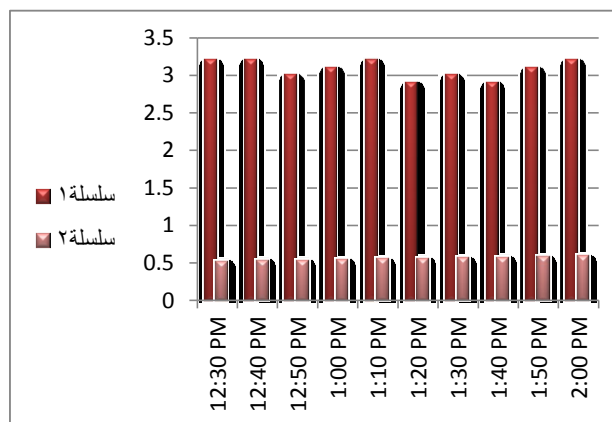

القطر و انية


Rated : 250 KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
12:30	239.3	238.8	238.6	414.05	413.53	413.59	19	10.6	14.5	3.2	0.98
12:40	239.4	238.9	238.9	414.34	413.8	414.09	18.6	10.1	14.2	3.2	0.98
12:50	239.1	238.6	238.78	413.81	413.38	413.49	18.8	10.1	14.2	3	0.95
13:00	239.2	238.7	238.8	414.02	413.65	413.61	17.6	10	14.3	3.1	0.97
13:10	238.9	238.4	238.5	413.56	413.1	413.04	19	10.5	13.8	3.2	0.98
13:20	239	238.7	238.9	413.86	413.89	413.47	18.6	10.3	13.9	2.9	0.92
13:30	239.1	238.7	238.7	414.05	413.49	413.43	17.5	10	14.6	3	0.97
13:40	239.3	238.8	239	414.15	414.1	413.74	18.6	9.3	12.5	2.9	0.95
13:50	238.7	238.7	237.9	414.02	414.23	413.54	19	9.2	12.6	3.1	0.97
14:00	238.5	238.2	238.41	414.35	414.12	413.26	17.8	9.5	13.2	3.2	0.98
avg. value							18.45	9.96	13.78	3.08	0.965
max. value							19	10.6	14.6	3.2	0.98

VEGA 78 Data for Domestic Load 10

Time	S (KVA)
12:30	4.2
12:40	4.1
12:50	4.1
13:00	4.1
13:10	4.2
13:20	4.2
13:30	4.1
13:40	4.1
13:50	4
14:00	4.2

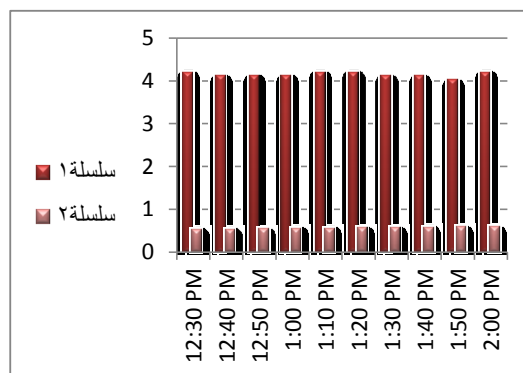

ادغيبس


Rated : 250 KVA

Date of record \2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
12:30	239.3	238.8	238.6	414.05	413.53	413.59	17.3	9.2	13.8	4.2	0.95
12:40	2349	238.9	238.9	414.34	413.8	414.09	17.3	9.1	13	4.1	0.94
12:50	239.1	238.6	238.78	413.81	413.38	413.8	16.8	9.1	13.5	4.1	0.94
13:00	239.2	238.7	238.8	414.02	413.65	413.61	17	9	12.7	4.1	0.94
13:10	238.9	238.4	238.5	413.56	413.1	412.9	16.1	9.2	13.7	4.2	0.95
13:20	239	238.7	238.9	413.86	413.89	413.47	16.9	8.7	12.6	4.2	0.95
13:30	239.4	238.7	238.7	413.9	413.49	413.43	17	9.1	12.6	4.1	0.95
13:40	239.3	238.8	239	414.15	414.1	413	17.6	9.3	13.1	4.1	0.94
13:50	238.9	238.7	237.9	414.02	414.23	413.54	16.6	9.2	12.8	4	0.93
14:00	238.5	238.2	238.41	414.35	414.12	413.26	16.8	8.5	13.2	4.2	0.95
avg. value							16.94	9.04	13.1	4.13	0.944
max. value							17.6	9.3	13.8	4.2	0.95

VEGA 78 Data for Domestic Load 11

Time	S (KVA)
08:30	19.4
08:40	18.93
08:50	19.96
09:00	20.25
09:10	20.2
09:20	18.85
09:30	18.37
09:40	18.3
09:50	18.69
10:00	18.38

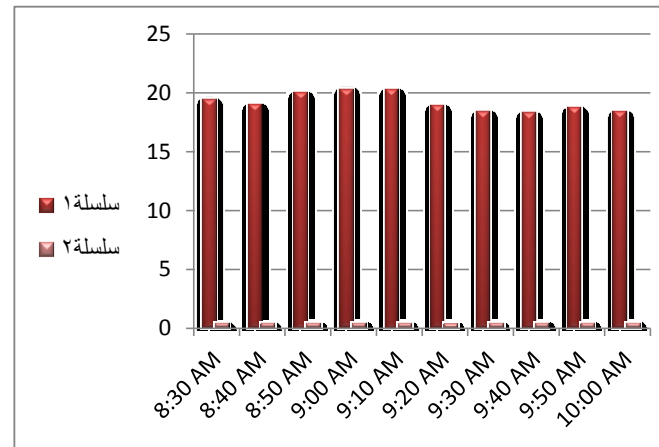

لوزة 1


150KVA

Date of record \2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
08:30	237.2	237	237.6	410.66	411.35	410.85	62.35	76.8	84.5	19.4	0.67
08:40	237.4	237.2	237.8	411.05	411.61	411.18	62.7	76.5	84.5	18.93	0.67
08:50	237.4	237.2	237.8	411.11	411.5	411.19	62.1	76.7	84.5	19.96	0.65
09:00	237.6	237.4	237.98	411.55	411.85	410.5	62.4	76.9	84.6	20.25	0.65
09:10	237.6	237.4	237.9	411.51	411.83	411.52	62	75.4	84.5	20.2	0.67
09:20	237.6	237.5	238	410.9	411.99	411.53	63.8	74.6	83.9	18.85	0.66
09:30	237.6	237.5	237.9	411.48	411.95	411.43	62.4	78.2	83.89	18.37	0.67
09:40	237.7	237.5	238	411.62	412.05	411.72	62.2	76.5	83.5	18.3	0.63
09:50	237.7	237.6	238.1	411.69	412.23	411.66	63.4	76.8	85.02	18.69	0.65
10:00	237.5	237.4	237.9	411.38	411.91	411.46	63.5	79.5	84.5	18.38	0.66
avg. value							62.685	76.79	84.341	19.133	0.658
max. value							63.8	79.5	85.02	20.25	0.67

VEGA 78 Data for Domestic Load 12

Time	S (KVA)
11:00	19.4
11:10	18.93
11:20	19.96
11:30	20.25
11:40	20.2
11:50	18.85
12:00	18.37
12:10	18.3
12:20	18.69
12:30	18.38

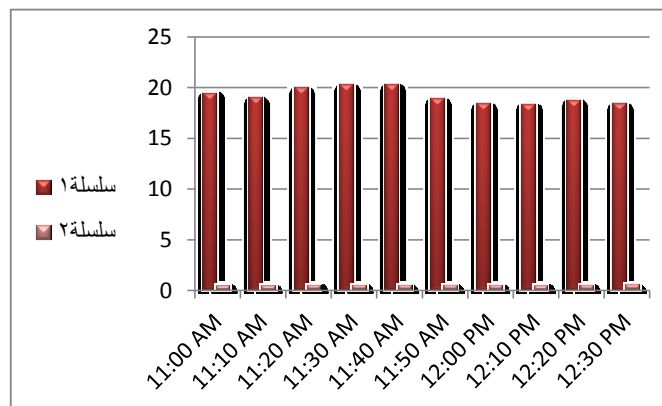

لوزة 2


400KVA

Date of record /2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
11:00	237.2	237	237.6	410.66	411.35	410.85	84	84.1	85	19.4	0.91
11:10	237.4	237.2	237.8	411.05	411.61	411.1	84.5	82.3	85.6	18.93	0.88
11:20	237.4	237.2	237.8	411.5	411.5	411.19	84.2	83.7	89.5	19.96	0.9
11:30	237.6	237.4	237.98	411.55	411.85	410.5	84	83.9	89.5	20.25	0.91
11:40	237.6	237.4	237.9	411.68	411.83	411.52	84.6	83.5	87	20.2	0.9
11:50	237.6	237.4	238	410.9	411.99	411.53	84.4	83.5	87.2	18.85	0.91
12:00	237.6	237.5	237.9	411.48	411.95	411.43	82.5	83.5	85.2	18.37	0.91
12:10	237.8	237.5	238	411.62	412.05	411.35	82.4	84.5	85.3	18.3	0.88
12:20	237.7	237.6	238.1	411.69	412.23	411.66	82.4	84.7	84.3	18.69	0.9
12:30	237.5	237.5	237.9	411.38	411.91	411.46	82.5	84.5	84.6	18.38	0.87
avg. value							83.55	83.82	86.32	19.133	0.897
max. value							84.6	84.7	89.5	20.25	0.91

VEGA 78 Data for Domestic Load 13

Time	S (KVA)
13:00	32
13:10	32
13:20	31.2
13:30	31.2
13:40	31.8
13:50	31.5
14:00	31.5
14:10	31.8
14:20	32
14:30	32

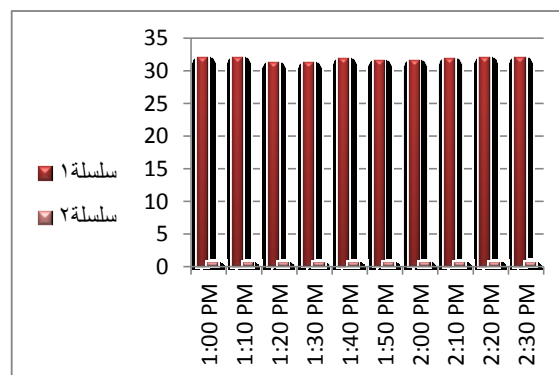

القرنة


400KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
13:00	237	237	237.6	410.66	411.35	410.85	138	63.9	115	32	0.88
13:10	237.4	237.2	237.8	411.05	411.61	411.1	138.8	63.2	115.2	32	0.88
13:20	237.4	237.2	237.8	411.5	411.5	411.19	135.2	62.9	115.2	31.2	0.87
13:30	237.6	237.4	237.9	411.3	411	410	138.4	63.9	115.6	31.2	0.87
13:40	237.6	237.5	237.9	411.68	411.83	411.52	136.6	63	115.3	31.8	0.88
13:50	237.6	237.4	238	410.9	411.99	411.53	135	63.5	115.8	31.5	0.86
14:00	237.6	237.5	237.9	411.48	411.95	411.43	135.5	63.5	116	31.5	0.86
14:10	237.5	237.5	238	411.62	412.05	411.35	135.4	63.8	114	31.8	0.87
14:20	237.7	237.6	238.1	411.69	412.23	411.66	135.8	63.5	114.8	32	0.88
14:30	237.5	237.5	237.9	411.38	411.91	411.46	135	63	114.8	32	0.88
avg. value							136.37	63.42	115.17	31.7	0.873
max. value							138.8	63.9	116	32	0.88

VEGA 78 Data for Domestic Load 14

Time	S (KVA)
15:00	18.99
15:10	18.93
15:20	19.96
15:30	20.25
15:40	20.2
15:50	18.85
16:00	18.37
16:10	18.3
16:20	18.69
16:30	18.38

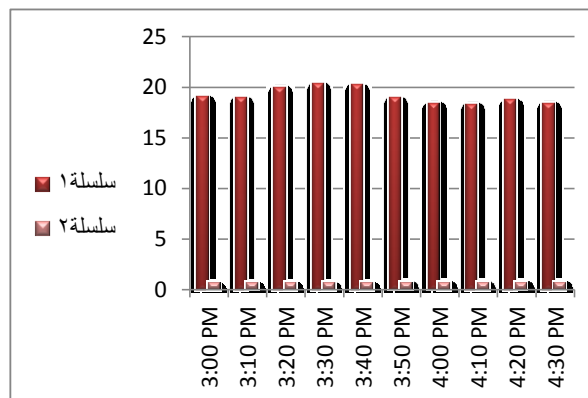

ابو دعجان

400KVA

Date of record 2017

Time	V1 (V)	V2 (V)	V3 (V)	V12 (V)	V23 (V)	V13 (V)	I1 (A)	I2 (A)	I3 (A)	S (KVA)	PF
15:00	237	237	237.6	410.66	411.35	410.85	80.1	42.6	63.7	18.99	0.92
15:10	237.4	237.2	237.8	411.05	411.61	411.3	80.7	42.3	63.2	18.93	0.92
15:20	237.4	237.2	237.8	411.5	411	411.19	80.1	43.7	62.8	19.96	0.9
15:30	237.6	237.4	237.9	411.55	411	410	80.4	43.5	60.5	20.25	0.91
15:40	237.6	237.5	237.8	411.68	411.83	411.52	81.4	43.5	61.9	20.2	0.92
15:50	237.6	237.5	238	410.9	411.99	411.53	83.4	48.7	63.2	18.85	0.88
16:00	237.65	237.5	237.9	411.48	411.95	411.43	82.5	43.6	63.5	18.37	0.9
16:10	237.6	237.5	238	411.62	412.05	411.35	82.2	42.5	61.4	18.3	0.87
16:20	237.7	237.6	238.1	411.69	412.23	411.66	82.2	43.5	62.8	18.69	0.92
16:30	237.5	237.5	237.9	411.38	411.91	411.46	82.3	43.5	61.2	18.38	0.9
avg. value							81.53	43.74	62.42	19.092	0.904
max. value							83.4	48.7	63.7	20.25	0.92

